


DETAIL  
**SUMP DETAILS**  
No Storm Lateral  
SECTION & DETAILS

PERMIT  
APPLICATION #

REVIEWED BY:  
DATE:

DWG. NO.  
**X08**  
FEB. 2012

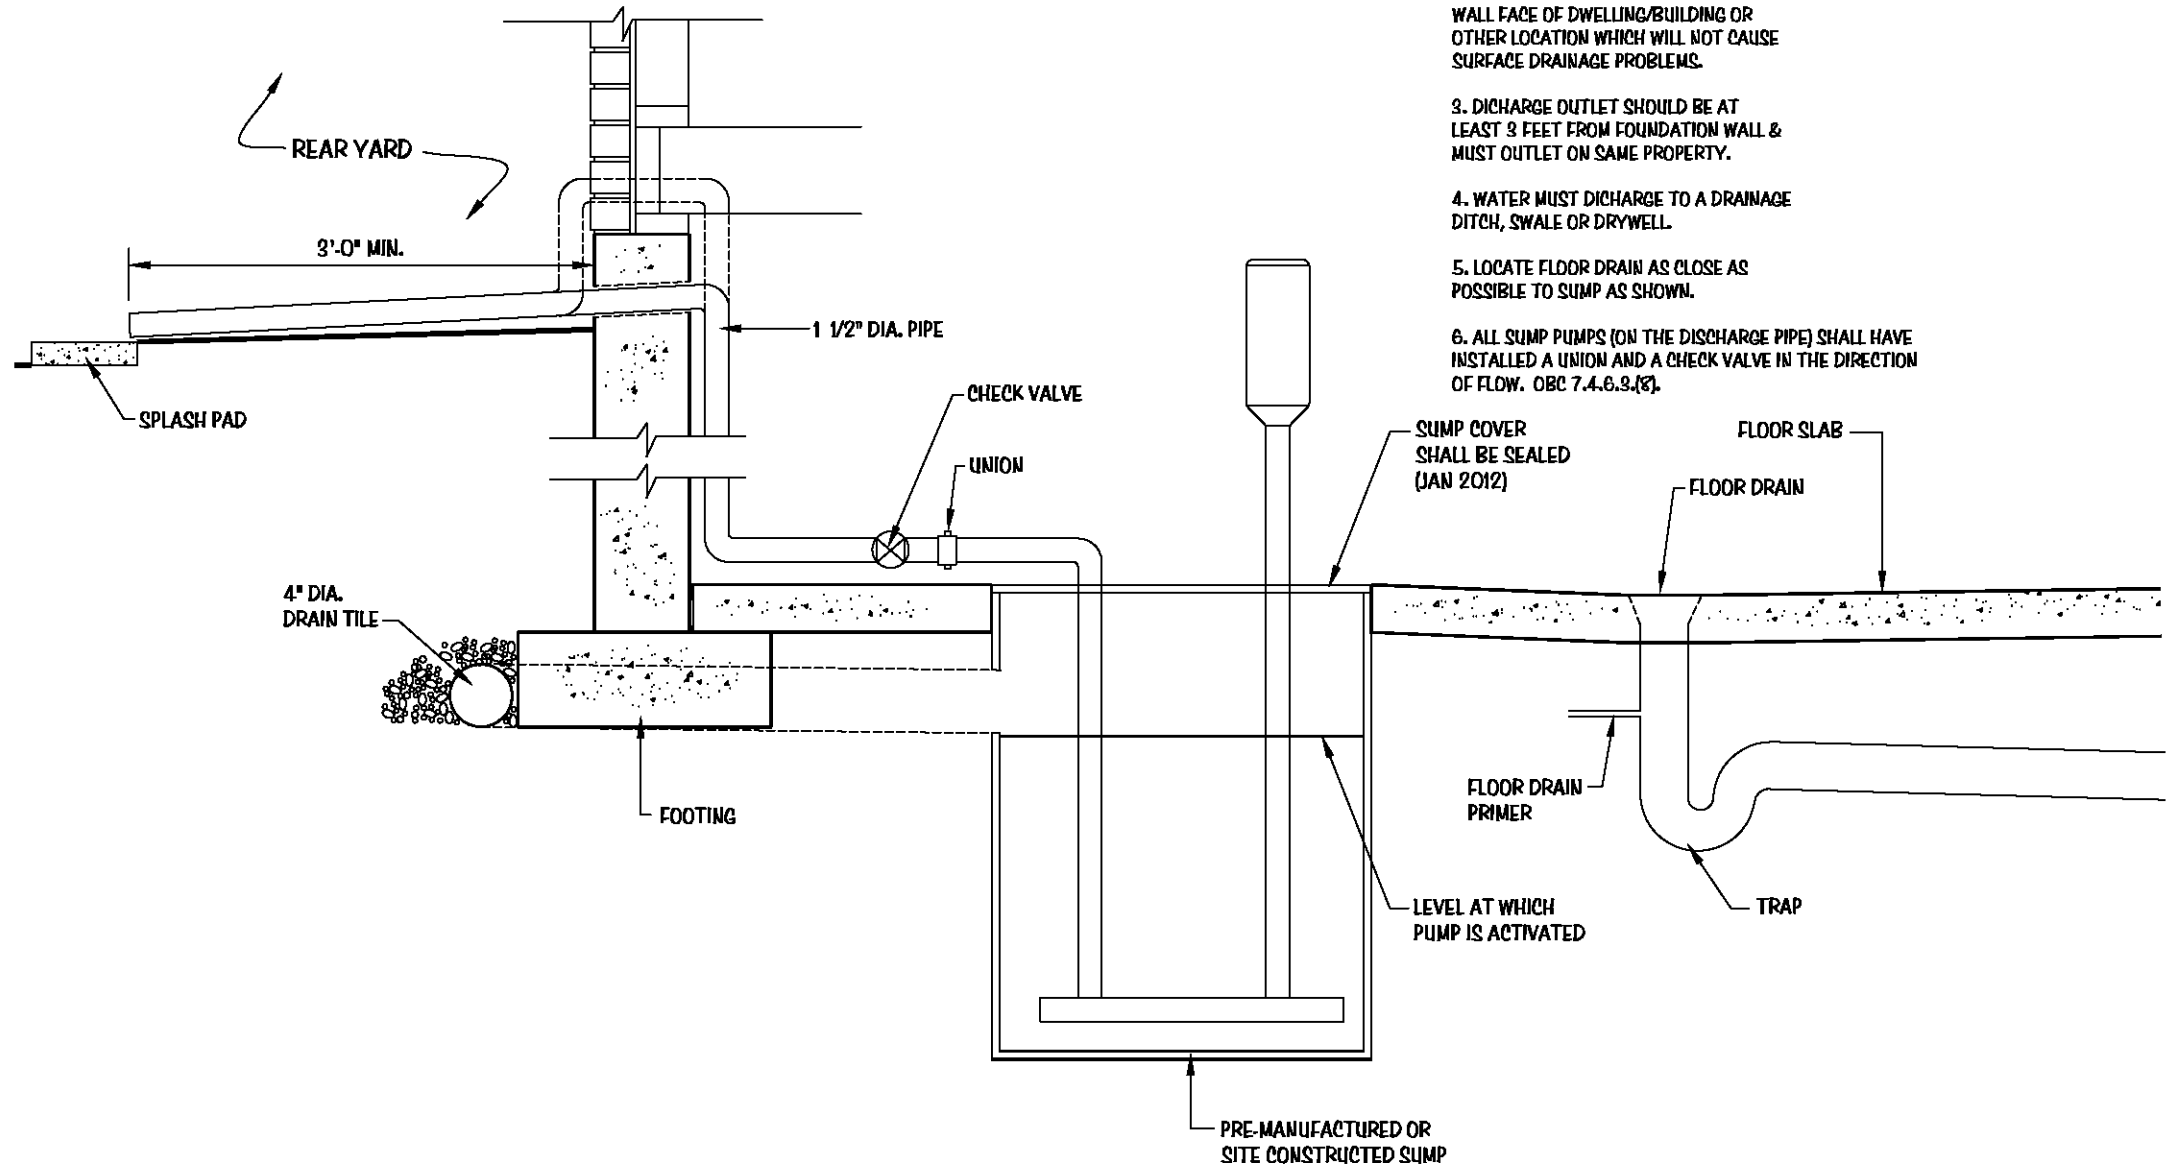

**NOTES :**

1. FOUNDATION DRAIN MUST NOT BE CONNECTED TO SANITARY SEWER SYSTEM IN NEW CONSTRUCTION UNLESS APPROVED OTHERWISE.
2. DISCHARGE OUTLET MUST BE AT REAR WALL FACE OF DWELLING/BUILDING OR OTHER LOCATION WHICH WILL NOT CAUSE SURFACE DRAINAGE PROBLEMS.
3. DISCHARGE OUTLET SHOULD BE AT LEAST 3 FEET FROM FOUNDATION WALL & MUST OUTLET ON SAME PROPERTY.
4. WATER MUST DISCHARGE TO A DRAINAGE DITCH, SWALE OR DRYWELL.
5. LOCATE FLOOR DRAIN AS CLOSE AS POSSIBLE TO SUMP AS SHOWN.
6. ALL SUMP PUMPS (ON THE DISCHARGE PIPE) SHALL HAVE INSTALLED A UNION AND A CHECK VALVE IN THE DIRECTION OF FLOW. OBC 7.4.6.9.(8).