



DET-11


SUMP DETAILS

With a Storm Lateral
SECTION & DETAILS

PERMIT
-PRIVILEGE #

DATE: _____
REVIEWED BY: _____

DWG. NO.
X08d
REV 2012

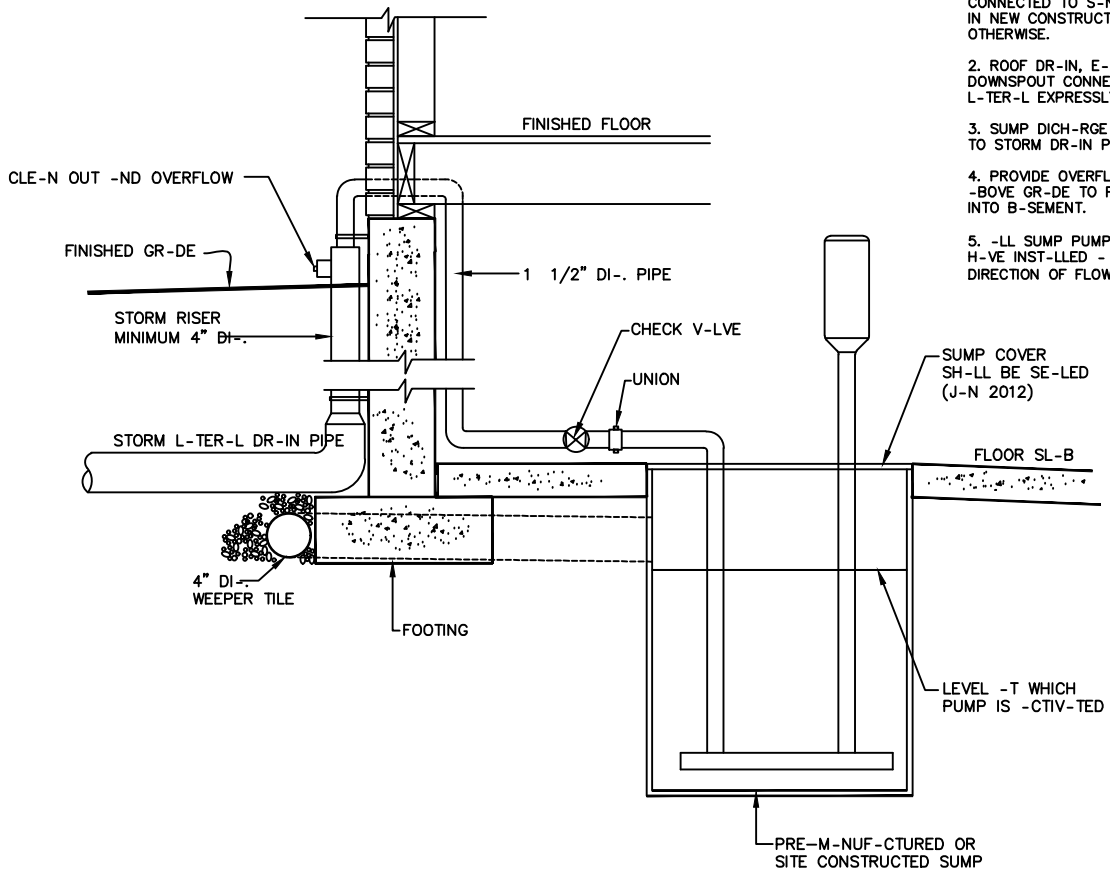

NOTES :

1. FOUNDATION DR-IN MUST NOT BE CONNECTED TO SEWER SYSTEM IN NEW CONSTRUCTION UNLESS APPROVED OTHERWISE.
2. ROOF DR-IN, E-VESTROUGH AND DOWNSPOUT CONNECTIONS TO STORM LATERAL EXPRESSLY PROHIBITED.
3. SUMP DISCHARGE OUTLET MUST BE CONNECTED TO STORM DR-IN PIPE RISER AS INDICATED.
4. PROVIDE OVERFLOW AT TOP OF STORM RISER ABOVE GRADE TO PREVENT STORM SURCHARGE INTO BASEMENT.
5. ALL SUMP PUMPS (ON THE DISCHARGE PIPE) SHALL HAVE INSTALLED UNION AND CHECK VALVE IN THE DIRECTION OF FLOW. OBC 7.4.6.3.(8).

SUMP COVER
SHALL BE SE-LED
(J-N 2012)

LEVEL AT WHICH
PUMP IS ACTIVATED

PRE-MANUFACTURED OR
SITE CONSTRUCTED SUMP